



Kitimat Airshed Group

QUARTERLY AIR QUALITY REPORT
JANUARY– MARCH 2025

Table of Contents

Report Summary	2
Kitimat Haisla Village	3
Kitimat Haul Road	7
Kitimat Industrial Ave.....	11
Kitimat Riverlodge.....	14
Kitimat Whitesail.....	19
Kitimat Yacht Club.....	23
Terrace Skeena Middle School.....	26
Downtime and Maintenance Reports	30

Report Summary

Quarterly Data Summary Reports for January 1 to March 31, 2025:

The first quarterly data summary report includes ambient air quality stations in Kitimat, Kitimaat Village and Terrace. These reports are automatically generated using unverified data extracted from the BC Air Data Archive (Envista database) managed by the Ministry of Environment and Climate Change Strategy (BCENV). Summary reports will be posted quarterly to provide an overview of the air quality status in the Kitimat Terrace airshed.

The Data Review Committee works collaboratively to bring the reports to the public. The air quality stations are owned and operated by Rio Tinto in the vicinity of Haisla Village, Kitimat and Lakelse Lake. RT also manages the maintenance and calibration activities through Trinity Consultants. Maintenance reports are provided at the end of the station reports. The Data Review Committee reviews the reports and provides context and comments.

Updates in the community include the following:

- While LNG Canada continued startup flaring, there were no exceedances at community stations.

All data was gathered in accordance to the data capture requirements, and key observations by the KAG for this quarter are as follows:

- There were no exceedances recorded at the community stations
- The fenceline station at Haul Road recorded an SO₂ reading greater than the metric value (65ppb).
- Haul Road wind sensor was frozen for 113 hours in January due to ice buildup. All stations had some impact from ice during this period.
- PM₁₀ ban failure due to water and ice intrusion caused a significant outage at Riverlodge from January 24 to February 8.

Submitted by Lindsay Sackett, Secretariat, on behalf of the Kitimat Airshed Group.



Ministry of
Environment and
Climate Change Strategy

Automated Data Summary for Kitimat Haisla Village 2025 Q1

Provided to the Kitimat Airshed Group by the
B.C. Ministry of Environment and Climate Change Strategy

Generated:
1 April 2025

Note

This report is generated automatically and contains unvalidated data.

Kitimat Haisla Village


2025 Q1

Parameter	Unit	Avg Prd	Obj	Excd	Qtr Avg	% Neg	Min	Max	Prd of Max	% Comp	Comp
AQHI		1 H					1	3	More than 5 occurrences (n = 25)	64.2	Y
NO2	ppb	1 H	60	0	0.6	0.0	0	25.3	3/5/2025 12:00 PM	91.5	Y
SO2	ppb	1 H	65	0	0.5	0.0	0.1	26.2	1/27/2025 24:00 AM	93.0	Y
O3	ppb	1 H	82	0	24.0	0.0	2.9	47.9	3/20/2025 2:00 AM	93.6	Y
PM2.5	ug/m3	1 H			6.1	0.0	0	26	2025-01-06 09:00:00 2025-01-06 21:00:00	97.8	Y
	ug/m3	24 H	25	0	6.1	0.0	2.3	11	2025-01-06	97.8	Y
Wind spd	m/s	1 H			2.9	0.0	0.36	9.89	2025-02-02 15:00:00	98.8	Y
Temp	°C	1 H			1.4		-12.8	16.6	2025-03-30 16:00:00	98.8	Y

Avg = Average; Comp = Completeness; Excd = number of exceedances; Neg = negative data; Obj = Air quality objective; Prd = Period; Qtr = Quarter
Comp threshold is 60%


Parameter	Conversion	Unit	Notes
AQHI			
NO2	1 : 1.88	ppb : ug/m3	
SO2	1 : 2.62	ppb : ug/m3	
O3	1 : 1.96	ppb : ug/m3	
PM2.5			
Wind spd			
Temp			

Windrose
Kitimat Haisla Village - 2025 Q1

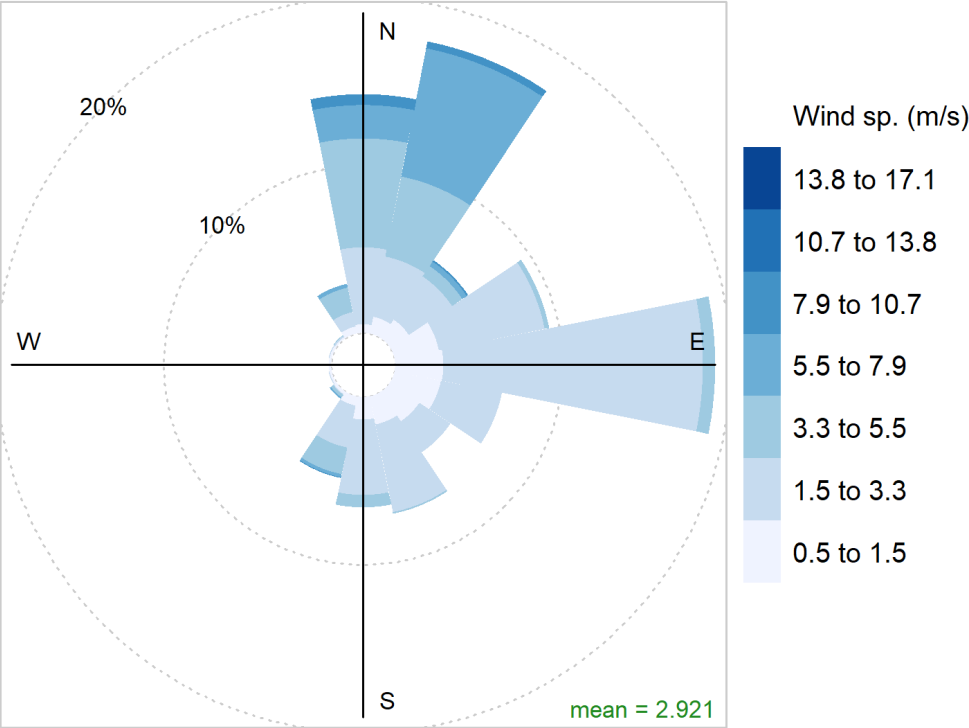


calms = 0.09%

SO2 pollution rose
Kitimat Haisla Village - 2025 Q1

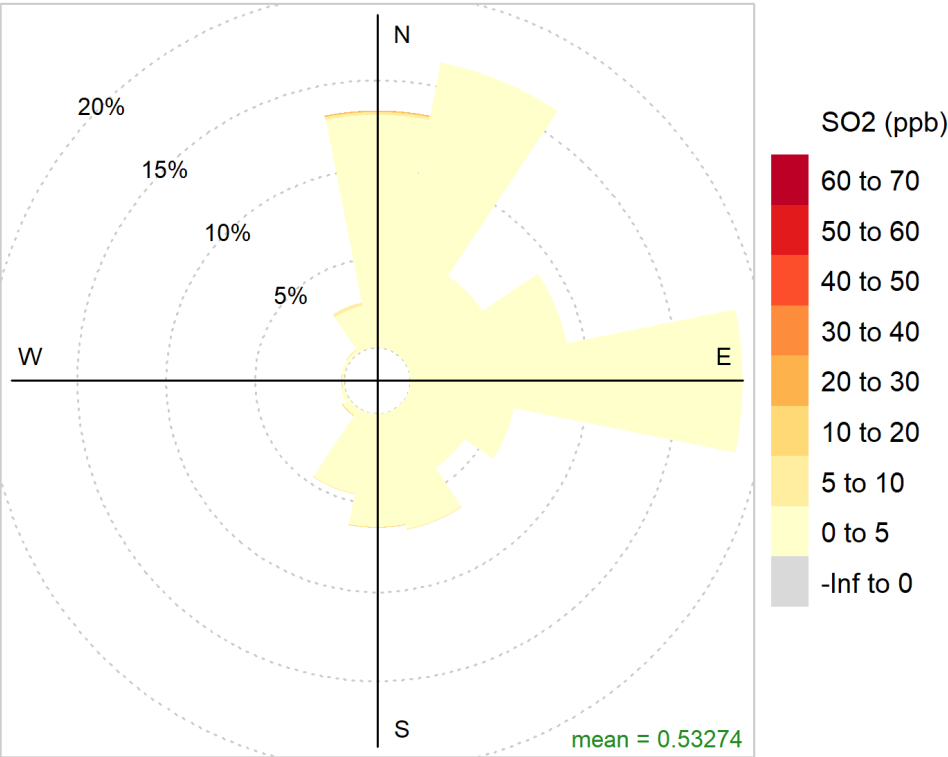

PM2.5 pollution rose
Kitimat Haisla Village - 2025 Q1

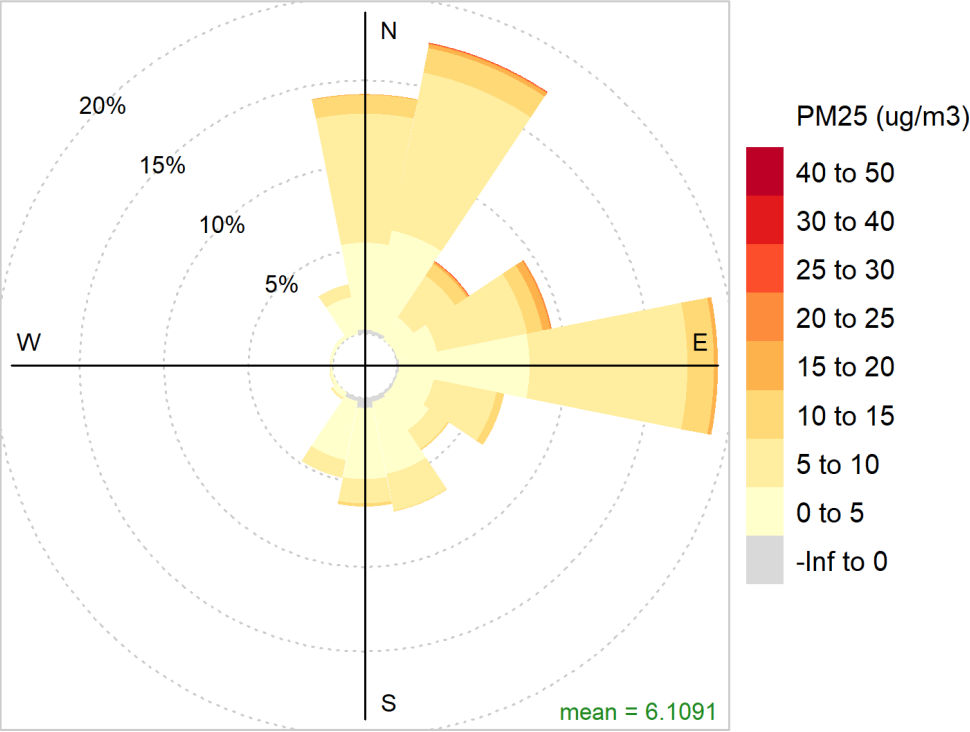



Ministry of
Environment and
Climate Change Strategy

Automated Data Summary for

Kitimat Haul Road 2025 Q1

Provided to the Kitimat Airshed Group by the
B.C. Ministry of Environment and Climate Change Strategy

Generated:
1 April 2025

Note

This report is generated automatically and contains unvalidated data.

Kitimat Haul Road


2025 Q1

Parameter	Unit	Avg Prd	Obj	Excd	Qtr Avg	% Neg	Min	Max	Prd of Max	% Comp	Comp
SO2	ppb	1 H	65	0	2.9	0.1	-0.3	67	1/10/2025 6:00 AM	94.3	Y
HF	ppb	1 H	63	0	0.1	0.0	0	0.2	More than 5 occurrences (n = 14)	94.1	Y
	ppb	24 H			0.1	0.0	0	0.2	2025-01-13 2025-01-14 2025-01-15	98.9	Y
PM2.5	ug/m3	1 H			4.0	0.0	0	50	2025-03-25 16:00:00	98.1	Y
	ug/m3	24 H	25	0	4.0	0.0	1.6	7.7	2025-01-08	98.9	Y
Wind spd	m/s	1 H			2.1	0.0	0	8.33	2025-01-29 18:00:00	92.8	Y
Temp	°C	1 H			0.3		-15.1	16.4	2025-03-30 17:00:00	98.6	Y

Avg = Average; Comp = Completeness; Excd = number of exceedances; Neg = negative data; Obj = Air quality objective; Prd = Period; Qtr = Quarter
Comp threshold is 60%


Parameter	Conversion	Unit	Notes
SO2	1 : 2.62	ppb : ug/m3	
HF	1 : 0.82	ppb : ug/m3	
PM2.5			
Wind spd			
Temp			

Windrose
Kitimat Haul Road - 2025 Q1

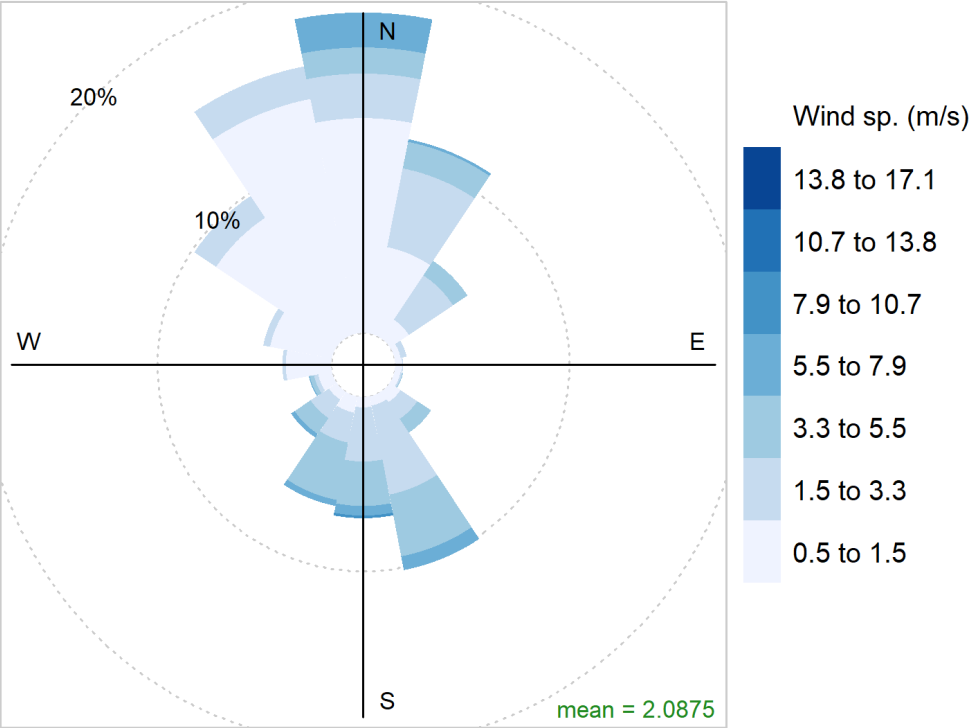


calms = 1.43%

SO2 pollution rose
Kitimat Haul Road - 2025 Q1

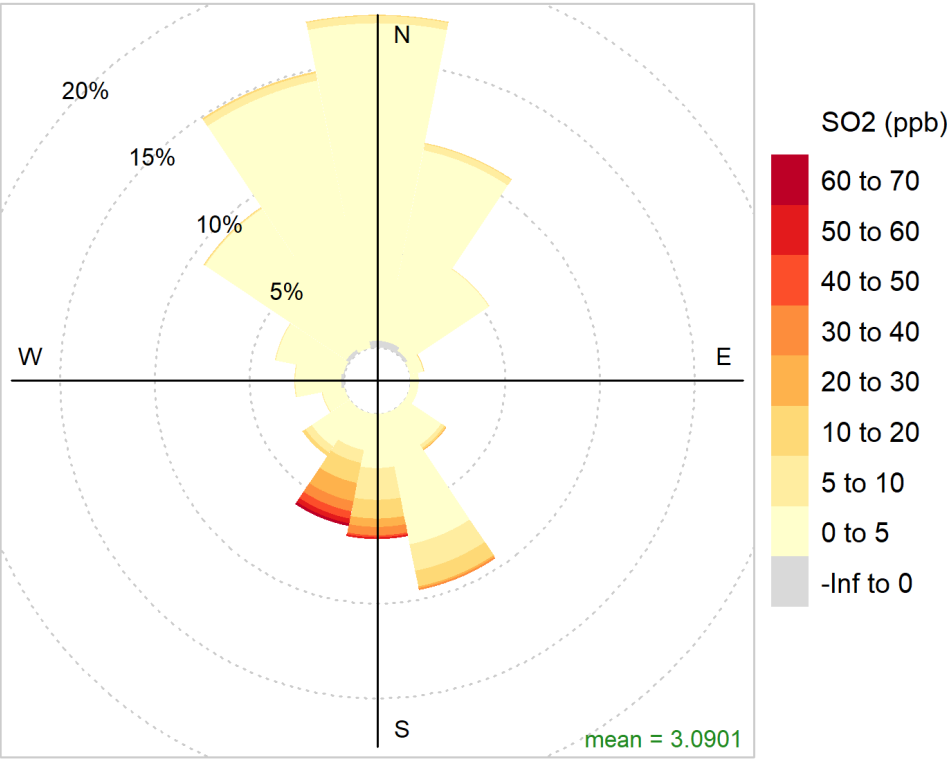

PM2.5 pollution rose
Kitimat Haul Road - 2025 Q1

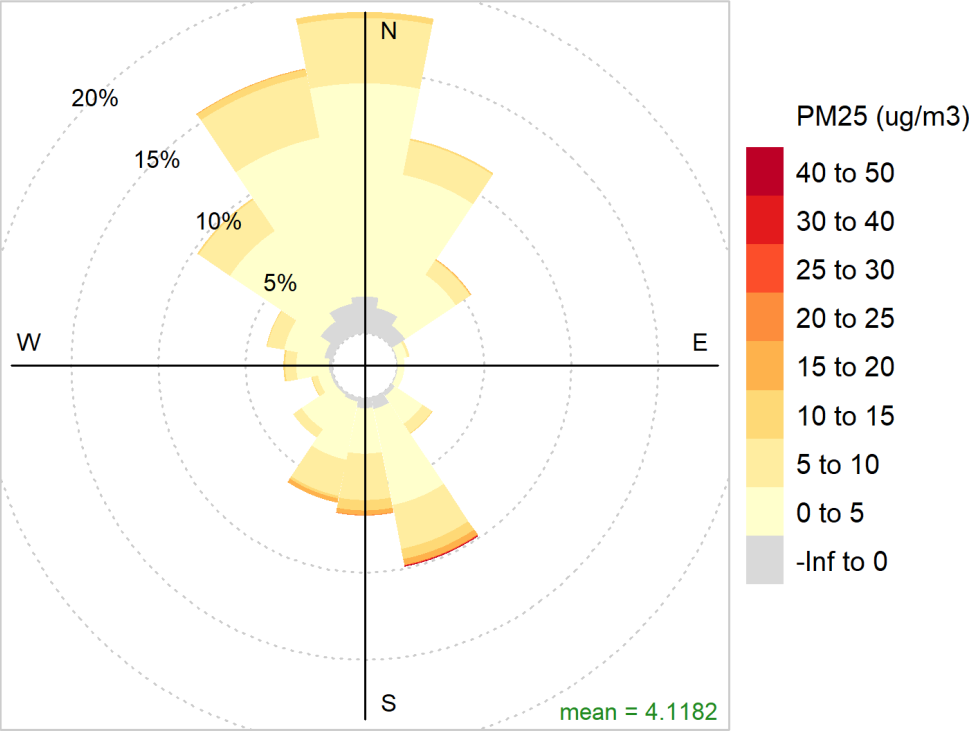



Automated Data Summary for Kitimat Industrial Ave 2025 Q1

Provided to the Kitimat Airshed Group by the
B.C. Ministry of Environment and Climate Change Strategy

Generated:
1 April 2025

Note

This report is generated automatically and contains unvalidated data.

Kitimat Industrial Ave


2025 Q1

Parameter	Unit	Avg Prd	Obj	Excd	Qtr Avg	% Neg	Min	Max	Prd of Max	% Comp	Comp
SO2	ppb	1 H	65	0	1.5	1.8	-0.5	34.5	1/27/2025 3:00 PM	92.7	Y
Wind spd	m/s	1 H			1.9	0.0	0	8.6	2025-02-02 11:00:00 2025-02-02 12:00:00	98.7	Y
Temp	°C	1 H			0.3		-16.1	17.3	2025-03-30 16:00:00	98.7	Y
Humidity	% RH	1 H			80.6	0.0	27.1	96.9	2025-01-10 01:00:00	98.7	Y

Avg = Average; Comp = Completeness; Excd = number of exceedances; Neg = negative data; Obj = Air quality objective; Prd = Period; Qtr = Quarter
Comp threshold is 60%


Parameter	Conversion	Unit	Notes
SO2	1 : 2.62	ppb : ug/m3	
Wind spd			
Temp			
Humidity			

Windrose
Kitimat Industrial Ave - 2025 Q1

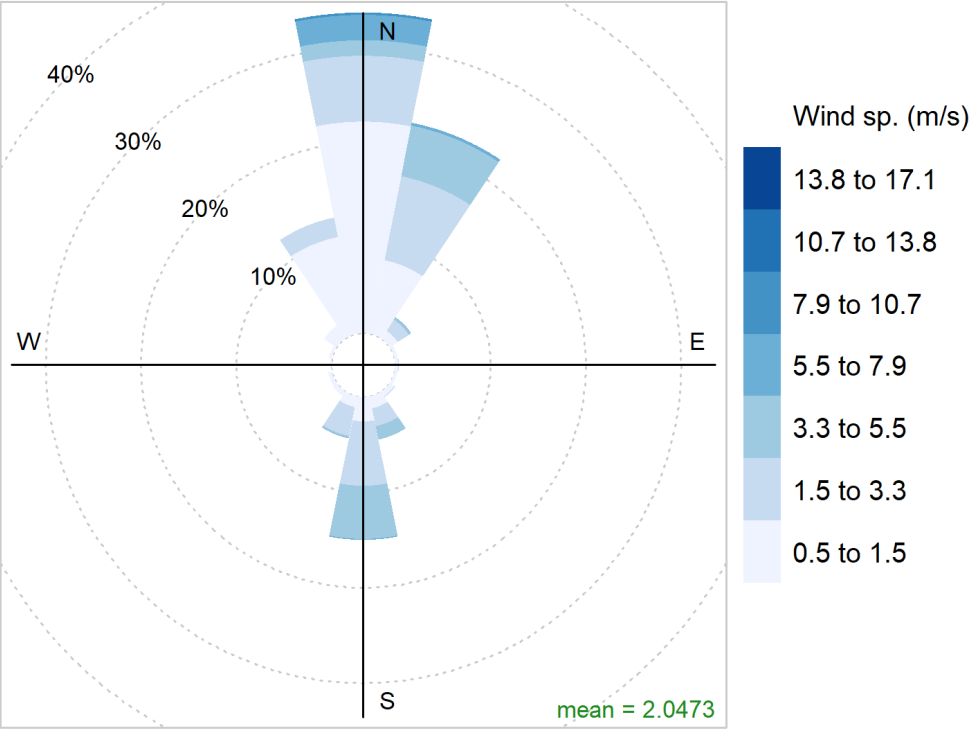

calms = 3.15%

SO2 pollution rose
Kitimat Industrial Ave - 2025 Q1

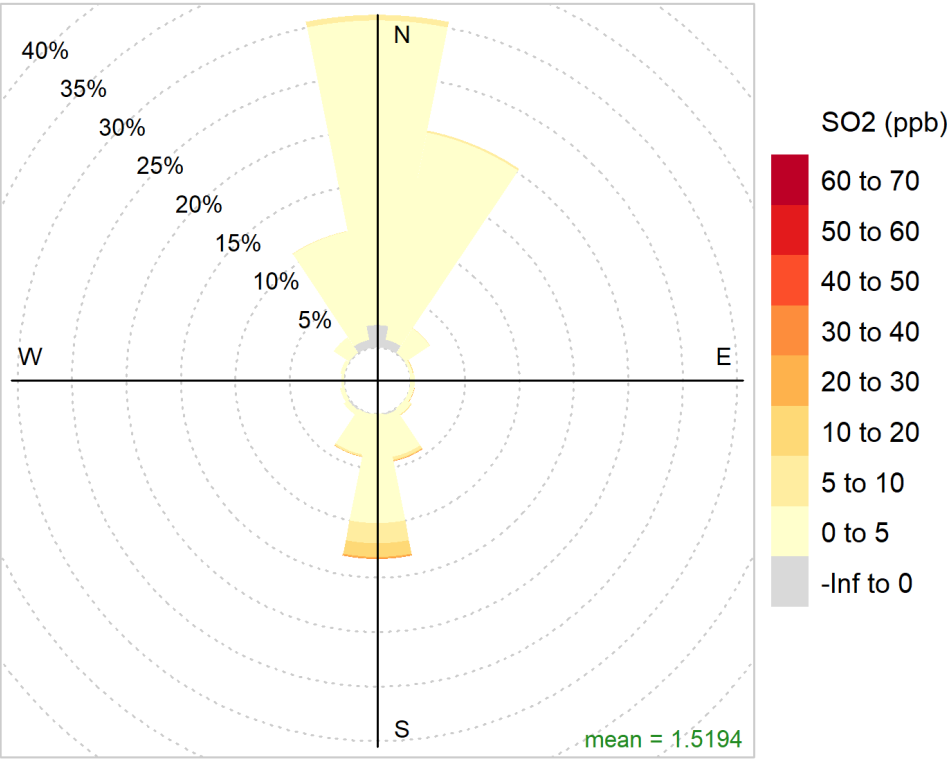



Ministry of
Environment and
Climate Change Strategy

Automated Data Summary for

Kitimat Riverlodge 2025 Q1

Provided to the Kitimat Airshed Group by the
B.C. Ministry of Environment and Climate Change Strategy

Generated:
1 April 2025

Note

This report is generated automatically and contains unvalidated data.

Kitimat Riverlodge

2025 Q1


Parameter	Unit	Avg Prd	Obj	Excd	Qtr Avg	% Neg	Min	Max	Prd of Max	% Comp	Comp
AQHI		1 H					1	3	More than 5 occurrences (n = 22)	31.6	N
NO2	ppb	1 H	60	0	1.6	0.0	0.1	11.7	1/7/2025 4:00 PM	93.6	Y
SO2	ppb	1 H	65	0	0.5	22.5	-0.3	31.9	1/27/2025 2:00 PM	93.6	Y
O3	ppb	1 H	82	0	22.4	0.0	0.6	46.4	3/20/2025 2:00 AM	93.6	Y
HF	ppb	1 H	63	0	0.1	0.0	0	0.1	More than 5 occurrences (n = 83)	93.6	Y
	ppb	24 H			0.1	0.0	0	0.1	More than 5 occurrences (n = 71)	98.9	Y
PM2.5	ug/m3	1 H			4.2	0.0	0	22	2025-01-06 19:00:00	97.9	Y
	ug/m3	24 H	25	0	4.2	0.0	1.8	7.8	2025-02-15	98.9	Y
PM10	ug/m3	1 H			8.5	0.0	0	71	2025-01-20 09:00:00	77.9	Y
	ug/m3	24 H	50	0	8.5	0.0	3.9	18.5	2025-03-04	77.8	Y
Wind spd	m/s	1 H			2.0	0.0	0	6.11	2025-02-02 14:00:00	98.8	Y
Temp	°C	1 H			0.7		-15.5	16.4	2025-03-30 17:00:00	98.8	Y

Avg = Average; Comp = Completeness; Excd = number of exceedances; Neg = negative data; Obj = Air quality objective; Prd = Period; Qtr = Quarter
Comp threshold is 60%

Parameter	Conversion	Unit	Notes
AQHI			
NO2	1 : 1.88	ppb : ug/m3	
SO2	1 : 2.62	ppb : ug/m3	
O3	1 : 1.96	ppb : ug/m3	
HF	1 : 0.82	ppb : ug/m3	
PM2.5			
PM10			


Parameter	Conversion Unit	Notes
Wind spd		
Temp		

Windrose
Kitimat Riverlodge - 2025 Q1

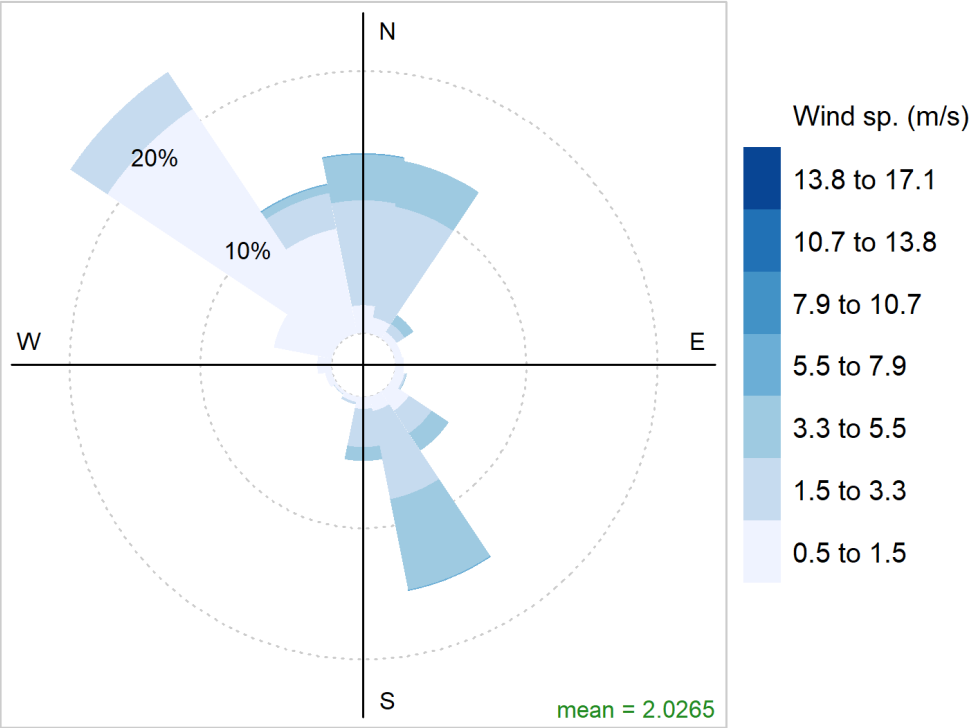


calms = 3.29%

SO2 pollution rose
Kitimat Riverlodge - 2025 Q1

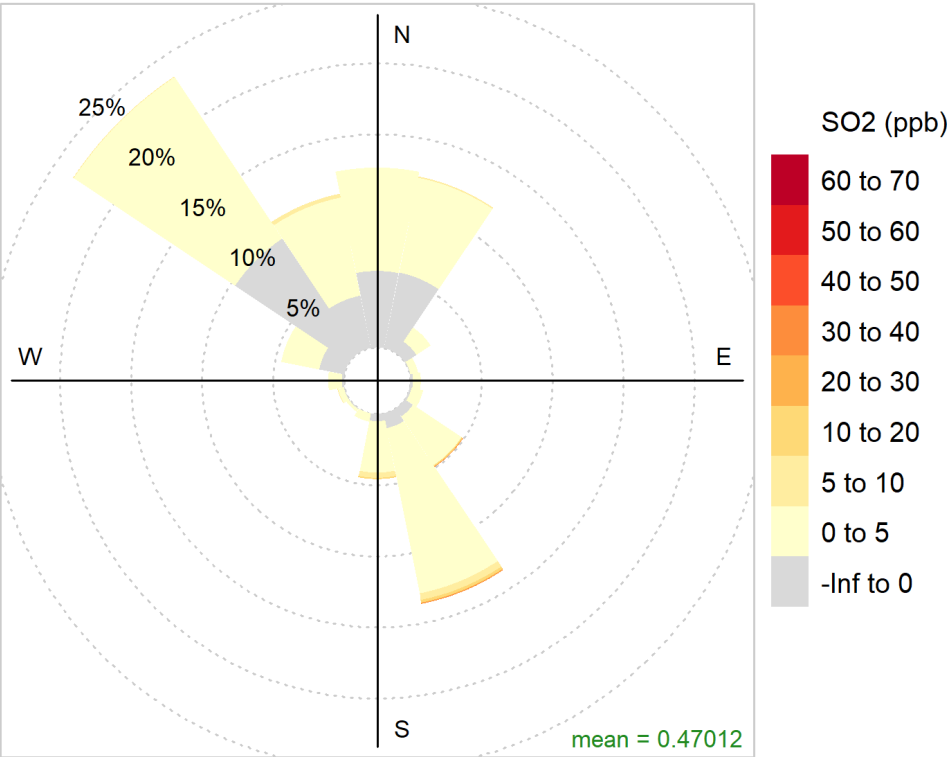

PM2.5 pollution rose
Kitimat Riverlodge - 2025 Q1

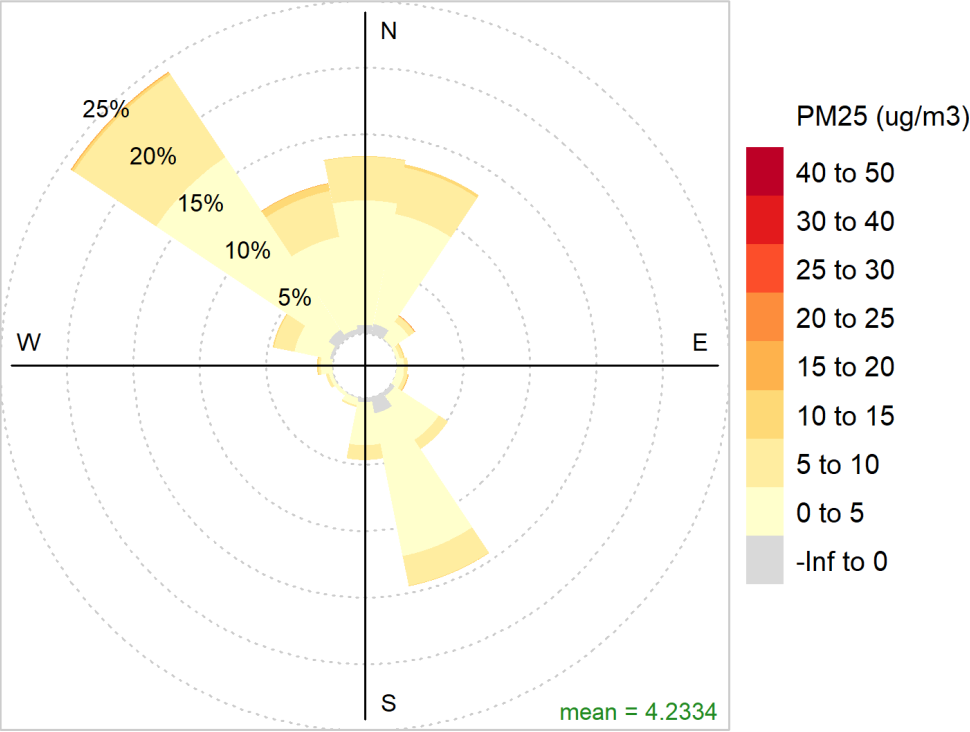



Ministry of
Environment and
Climate Change Strategy

Automated Data Summary for

Kitimat Whitesail 2025 Q1

Provided to the Kitimat Airshed Group by the
B.C. Ministry of Environment and Climate Change Strategy

Generated:
1 April 2025

Note

This report is generated automatically and contains unvalidated data.

Kitimat Whitesail


2025 Q1

Parameter	Unit	Avg Prd	Obj	Excd	Qtr Avg	% Neg	Min	Max	Prd of Max	% Comp	Comp
AQHI		1 H					1	3	2025-03-05 15:00:00	3.0	N
NO2	ppb	1 H	60	0	1.4	0.0	0.1	14.7	2/19/2025 8:00 PM	94.0	Y
SO2	ppb	1 H	65	0	0.1	37.5	-0.5	24.1	1/27/2025 2:00 PM	94.0	Y
O3	ppb	1 H	82	0	17.9	0.0	0.5	36.8	2/3/2025 12:00 PM	93.8	Y
PM2.5	ug/m3	1 H			4.2	0.0	0	27	2025-03-05 15:00:00	98.1	Y
	ug/m3	24 H	25	0	4.2	0.0	1.9	7.6	2025-03-05	98.9	Y
Wind spd	m/s	1 H			2.4	0.0	0	7.17	2025-01-29 01:00:00	98.8	Y
Temp	°C	1 H			0.4		-14.6	16	2025-03-30 17:00:00	98.8	Y
Humidity	% RH	1 H			82.9	0.0	31.2	100	More than 5 occurrences (n = 54)	98.8	Y

Avg = Average; Comp = Completeness; Excd = number of exceedances; Neg = negative data; Obj = Air quality objective; Prd = Period; Qtr = Quarter
Comp threshold is 60%


Parameter	Conversion	Unit	Notes
AQHI			
NO2	1 : 1.88	ppb : ug/m3	
SO2	1 : 2.62	ppb : ug/m3	
O3	1 : 1.96	ppb : ug/m3	
PM2.5			
Wind spd			
Temp			
Humidity			

Windrose
Kitimat Whitesail - 2025 Q1

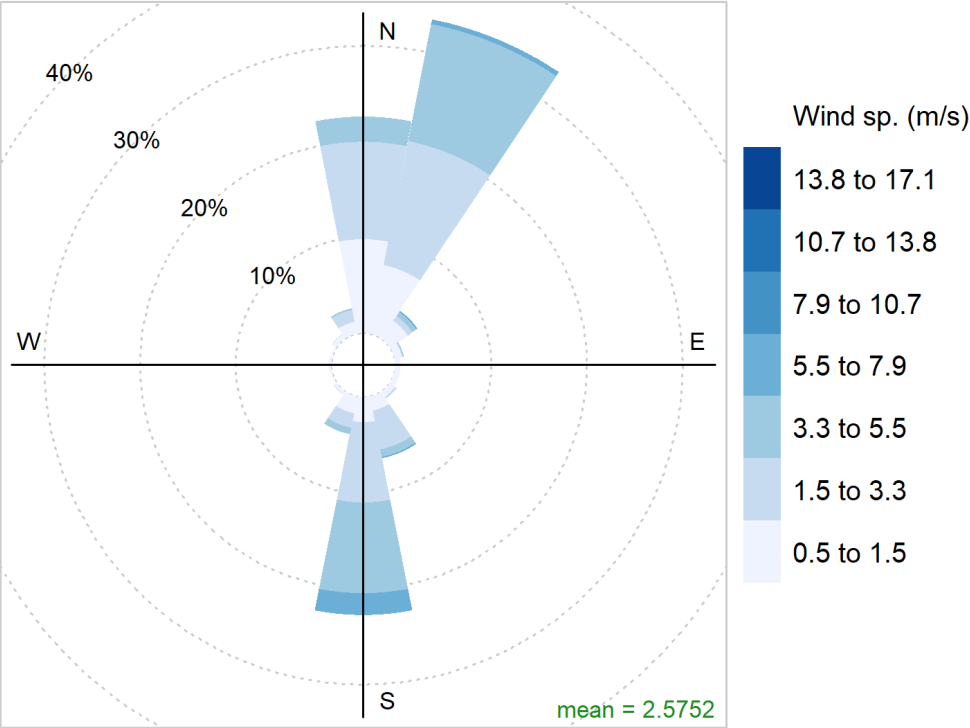


calms = 6.39%

SO2 pollution rose
Kitimat Whitesail - 2025 Q1

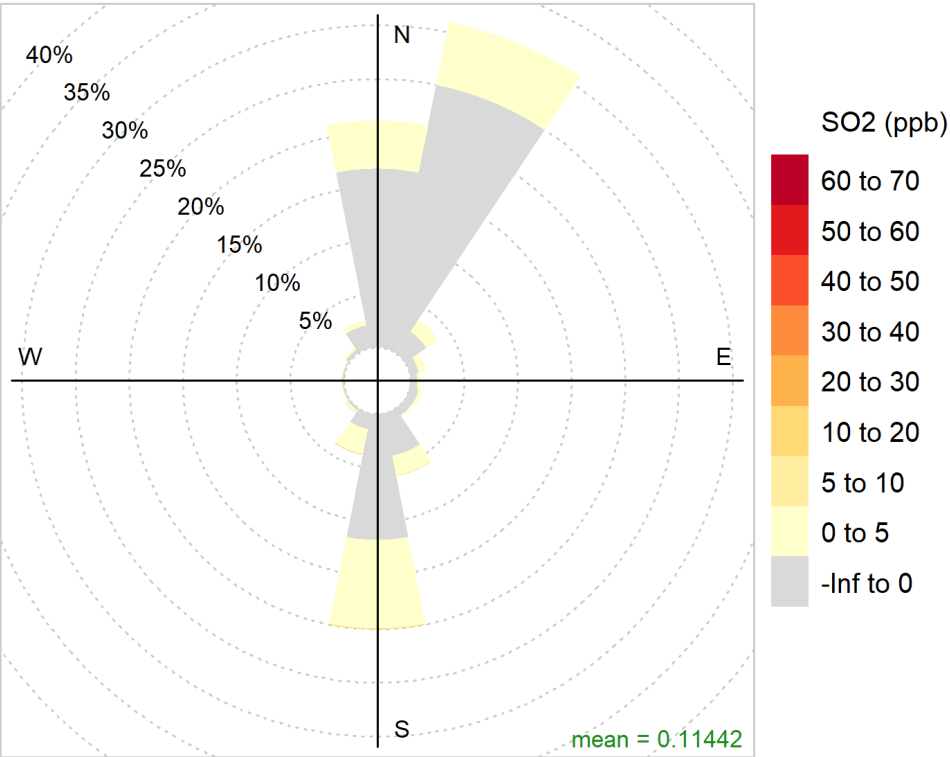

PM2.5 pollution rose
Kitimat Whitesail - 2025 Q1

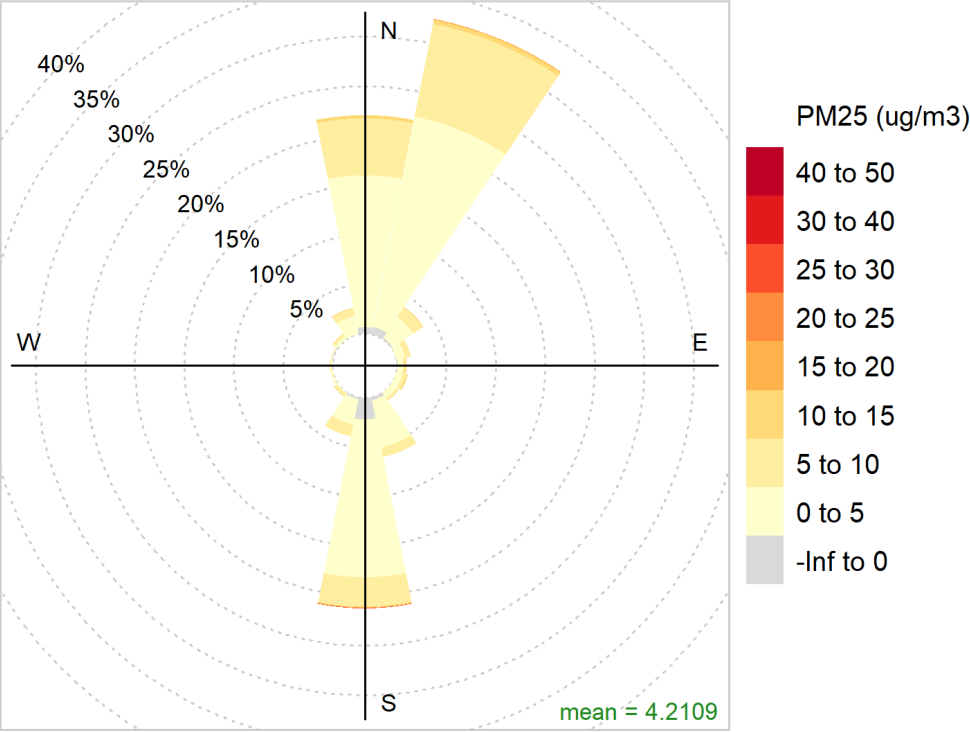



Automated Data Summary for

Kitimat Yacht Club 2025 Q1

Provided to the Kitimat Airshed Group by the
B.C. Ministry of Environment and Climate Change Strategy

Generated:
1 April 2025

Note

This report is generated automatically and contains unvalidated data.

Kitimat Yacht Club


2025 Q1

Parameter	Unit	Avg Prd	Obj	Excd	Qtr Avg	% Neg	Min	Max	Prd of Max	% Comp	Comp
Wind spd	m/s	1 H			3.8	0.0	0	10.62	2025-01-29 08:00:00	98.8	Y
Temp	°C	1 H			1.3		-12.7	15.9	2025-03-26 17:00:00	98.8	Y

Avg = Average; Comp = Completeness; Excd = number of exceedances; Neg = negative data; Obj = Air quality objective; Prd = Period; Qtr = Quarter
Comp threshold is 60%

Parameter	Conversion	Unit	Notes
Wind spd			
Temp			

Windrose
Kitimat Yacht Club - 2025 Q1

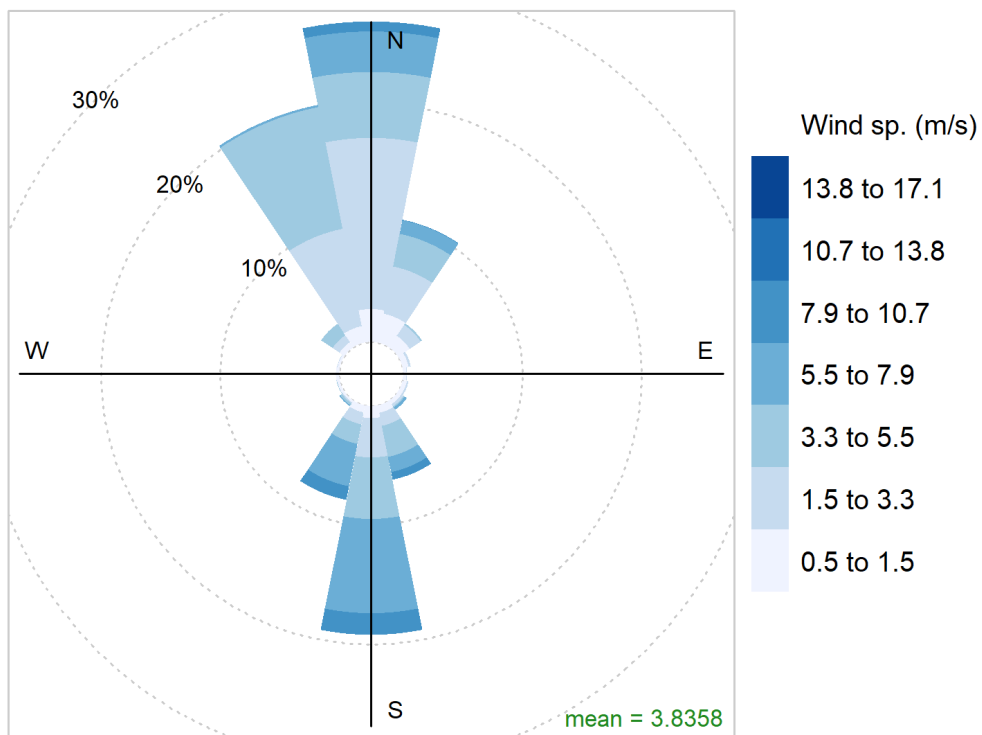

calms = 0.42%



Ministry of
Environment and
Climate Change Strategy

Automated Data Summary for
Terrace Skeena Middle School
2025 Q1

Provided to the Kitimat Airshed Group by the
B.C. Ministry of Environment and Climate Change Strategy

Generated:
1 April 2025

Note

This report is generated automatically and contains unvalidated data.

Terrace Skeena Middle School


2025 Q1

Parameter	Unit	Avg Prd	Obj	Excd	Qtr Avg	% Neg	Min	Max	Prd of Max	% Comp	Comp
AQHI		1 H					1	7	2025-01-20 09:00:00 2025-02-12 20:00:00	98.8	Y
NO2	ppb	1 H	60	0	1.7	45.0	-1.4	19.5	3/17/2025 8:00 AM	94.8	Y
SO2	ppb	1 H	65	0	0.2	35.1	-1.4	3.9	2025-03-10 12:00:00	94.7	Y
O3	ppb	1 H	82	0	24.2	0.0	0.4	46.1	3/20/2025 4:00 AM	94.8	Y
PM2.5	ug/m3	1 H			5.4	0.0	0	69.8	2025-01-20 09:00:00	98.8	Y
	ug/m3	24 H	25	0	5.4	0.0	1.4	15.8	2025-02-12	98.9	Y
Wind spd	m/s	1 H			1.6	0.0	0	6.08	2025-02-15 04:00:00	98.8	Y
Temp	°C	1 H			0.8		-14.6	16.4	2025-03-26 18:00:00	98.8	Y
Humidity	% RH	1 H			75.2	0.0	24.6	99.4	More than 5 occurrences (n = 66)	98.8	Y

Avg = Average; Comp = Completeness; Excd = number of exceedances; Neg = negative data; Obj = Air quality objective; Prd = Period; Qtr = Quarter
Comp threshold is 60%


Parameter	Conversion	Unit	Notes
AQHI			
NO2	1 : 1.88	ppb : ug/m3	
SO2	1 : 2.62	ppb : ug/m3	
O3	1 : 1.96	ppb : ug/m3	
PM2.5			
Wind spd			
Temp			
Humidity			

Windrose Terrace Skeena Middle School - 2025 Q1

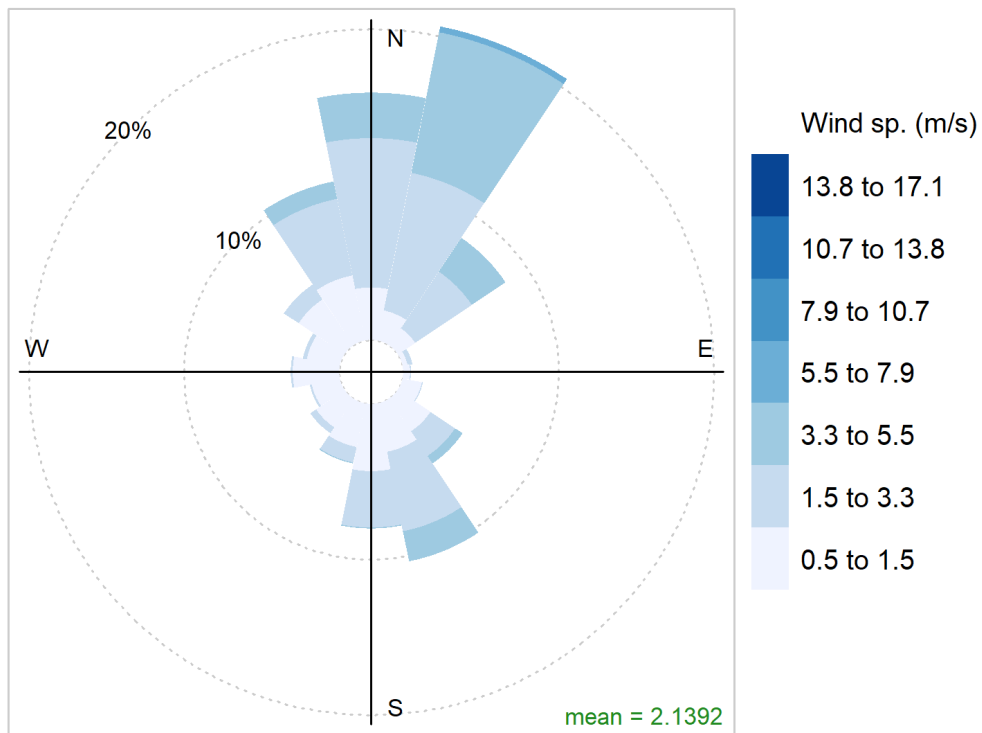


calms = 26.68%

SO2 pollution rose Terrace Skeena Middle School - 2025 Q1

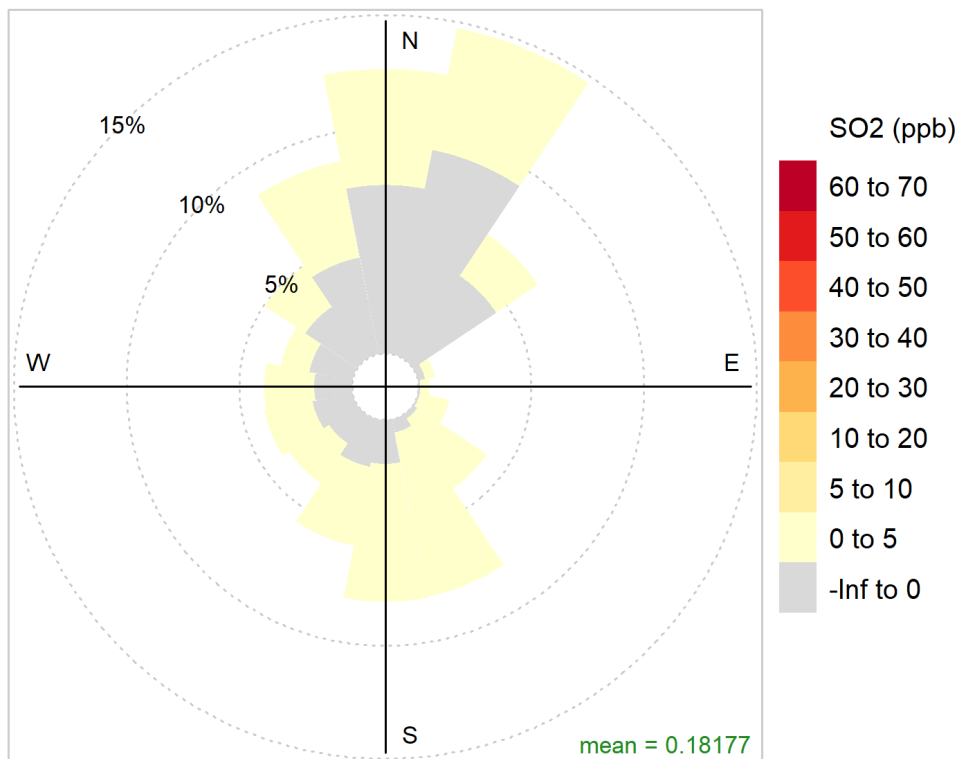

PM2.5 pollution rose
Terrace Skeena Middle School - 2025 Q1

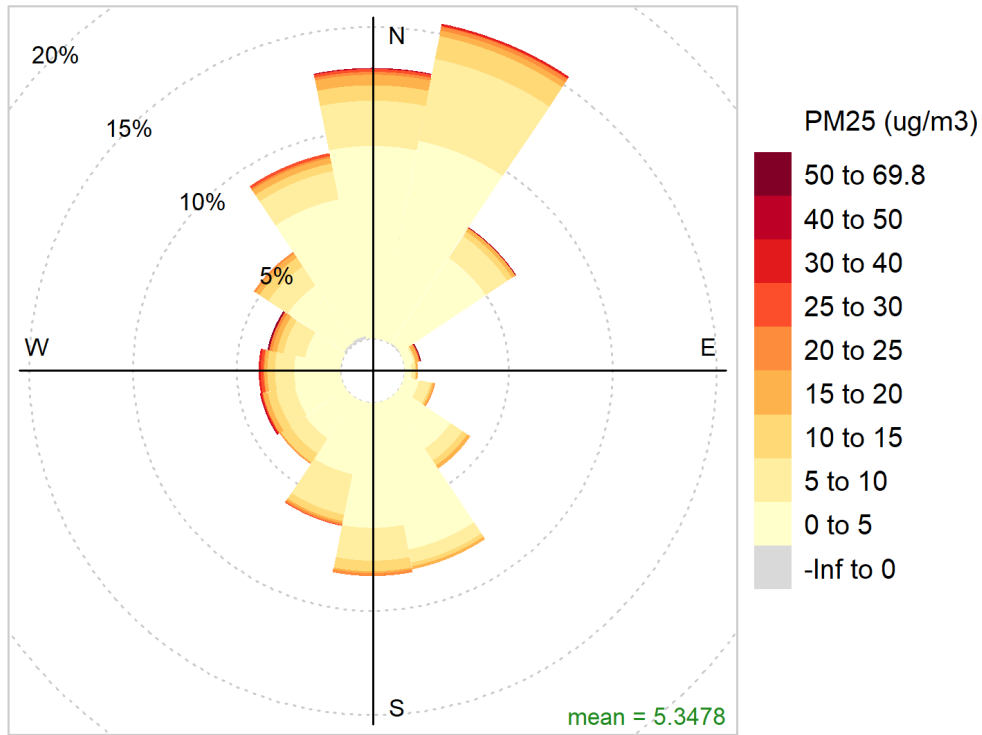

Downtime and Maintenance Reports from Trinity Consultants

Significant Offline Periods							
Station	Start Date	Start Hour	End Date	End Hour	Parameters	Description	# Hours
Village	2025-01-14	300	2025-01-14	1100	PM2.5	Tape Malfunction	9
Village	2025-01-22	1100	2025-01-22	1100	O3/NOx/SO2/PM	Power Outage	1
Village	2025-01-22	1200	2025-01-24	1100	NOx	Malfunction due to Power Outage	48
Village	2025-02-04	1700	2025-02-05	800	PM2.5	Analyzer Malfunction; Stabilized	16
Haul Road	2025-01-01	200	2025-01-01	1100	Wind	Frozen	10
Haul Road	2025-01-01	1600	2025-01-05	1300	Wind	Frozen	94
Haul Road	2025-01-06	200	2025-01-06	1100	Wind	Frozen	10
Haul Road	2025-01-06	2300	2025-01-07	1100	Wind	Frozen	13
Haul Road	2025-02-11	1600	2025-02-11	1600	HF	Intermittent Malfunction	1
Haul Road	2025-02-18	1300	2025-02-18	1400	HF	Intermittent Malfunction	2
Haul Road	2025-03-03	500	2025-03-03	900	Wind	Frozen	5
Industrial	2025-01-01	400	2025-01-01	1200	Wind	Frozen	9
Industrial	2025-01-07	800	2025-01-07	1100	Wind	Frozen	4
Industrial	2025-01-25	2200	2025-01-26	1000	Wind	Frozen	13
Industrial	2025-01-27	300	2025-01-27	700	Wind	Frozen	5
Industrial	2025-02-11	2100	2025-02-12	600	SO2	Flatlined; Rebooted	10
Industrial	2025-02-16	200	2025-02-16	800	SO2	Flatlined; Rebooted	7
Industrial	2025-02-20	2100	2025-02-21	600	SO2	Flatlined; Rebooted	10
Industrial	2025-02-21	1500	2025-02-21	1500	SO2	Power Outage	1
Industrial	2025-03-03	0	2025-03-03	900	Wind	Frozen	10
Industrial	2025-03-11	2200	2025-03-12	700	Wind	Frozen	10
Industrial	2025-03-14	1400	2025-03-14	1400	SO2	Power Outage	1
Riverlodge	2025-01-06	1000	2025-01-06	1000	Wind	Frozen	1
Riverlodge	2025-01-07	800	2025-01-07	1200	Wind	Frozen	5
Riverlodge	2025-01-10	2300	2025-01-11	100	PM10/PM2.5	Power Outages	3
Riverlodge	2025-01-24	1400	2025-02-08	800	PM10	Unit Failure due to Water/Ice Intrusion	355

Riverlodge	2025-01-25	2200	2025-01-26	1000	Wind	Frozen	13
Riverlodge	2025-02-01	2000	2025-02-04	1400	THC	Inlet Froze	67
Riverlodge	2025-02-17	2000	2025-02-17	2100	PM2.5	Tape Malfunction	2
Riverlodge	2025-02-18	200	2025-02-18	300	PM2.5	Tape Malfunction	2
Riverlodge	2025-03-20	2300	2025-03-21	500	THC	Flatlined; Rebooted	7
Riverlodge	2025-03-27	500	2025-03-27	500	O3/NOx/SO2/HF/THC/P M10/PM2.5	Power Outage	1
Riverlodge	2025-03-27	0	2025-03-27	400	THC	Flatlined	5
Whitesail	2025-01-10	2300	2025-01-11	100	O3/NOx/SO2/PM2.5	Power Outages	3
Whitesail	2025-02-19	2300	2025-02-19	2300	Wind	Frozen or Calm	1
Whitesail	2025-02-21	600	2025-02-21	600	Wind	Frozen or Calm	1
Whitesail	2025-02-28	800	2025-02-28	800	Wind	Frozen or Calm	1
Whitesail	2025-02-28	1000	2025-02-28	1000	Wind	Frozen or Calm	1
Whitesail	2025-03-17	1600	2025-03-17	1700	PM2.5	Tape Malfunction	2
Whitesail	2025-03-27	500	2025-03-27	500	O3/NOx/SO2/PM2.5	Power Outage	1
Yacht Club	2025-01-01	800	2025-01-01	1300	Wind	Frozen	6
Maintenance							
Station	Start Date	Start Hour	End Date	End Hour	Parameters	Description	# Hours
Village	2025-01-09	1000	2025-01-09	1000	SO2/O3/NOx	Replace Filters	1
Village	2025-01-14	1100	2025-01-14	1100	PM2.5	Leak Check / Tape Change	1
Village	2025-01-21	900	2025-01-21	900	SO2/O3/NOx	O3 As Found MP Verification	1
Village	2025-01-21	1000	2025-01-21	1200	SO2/O3/NOx	O3 Maintenance	3
Village	2025-01-22	1300	2025-01-22	1400	SO2/O3/NOx	O3 MP After Adjustment	2
Village	2025-01-24	1200	2025-01-24	1400	SO2/O3/NOx	NOx Calibration	3
Village	2025-01-27	1600	2025-01-27	1800	SO2/O3/NOx	NOx Troubleshooting / Repair / Calibration	3
Village	2025-01-28	1600	2025-01-28	1800	PM2.5	Monthly Flow Rate Verification and Maintenance	3
Village	2025-02-05	1000	2025-02-05	1100	SO2/O3/NOx	SO2 Calibration	2
Village	2025-02-13	1200	2025-02-13	1200	SO2/O3/NOx	Filters Changed	1

Village	2025-02-17	1700	2025-02-17	1800	PM2.5	Monthly Flow Rate Verification and Maintenance	2
Village	2025-02-27	1200	2025-02-27	1300	SO2/O3/NOx/PM2.5	MOE Audit	2
Village	2025-03-04	1600	2025-03-04	1600	SO2/O3/NOx/PM2.5	Filters Changed	1
Village	2025-03-04	1600	2025-03-04	1700	PM2.5	Monthly Flow Rate Verification and Maintenance	2
Haul Road	2025-01-03	1200	2025-01-03	1200	SO2/HF	Filter Replaced	1
Haul Road	2025-01-23	1100	2025-01-23	1200	PM2.5	Monthly Flow Rate Verification and Maintenance	2
Haul Road	2025-02-06	1400	2025-02-06	1500	PM2.5	Monthly Flow Rate Verification and Maintenance	2
Haul Road	2025-02-27	1000	2025-02-27	1100	SO2/HF/PM2.5	MOE Audit	2
Haul Road	2025-03-06	1200	2025-03-06	1200	SO2/HF	HF As Found MP Verification	1
Haul Road	2025-03-06	1400	2025-03-06	1500	PM2.5	Monthly Flow Rate Verification and Maintenance	2
Haul Road	2025-03-20	2100	2025-03-20	2200	SO2/HF	SO2 As Found MP Verification	2
Industrial	2025-01-02	1000	2025-01-02	1200	SO2	SO2 Calibration	3
Industrial	2025-02-06	1500	2025-02-06	1500	SO2	Filter Changed	1
Industrial	2025-02-07	900	2025-02-07	1100	SO2	SO2 Calibration	3
Industrial	2026-02-26	1200	2026-02-26	1300	SO2	MOE Audit	2
Industrial	2025-03-04	1100	2025-03-04	1500	SO2	SO2 Calibration	5
Riverlodge	2025-01-03	1000	2025-01-03	1000	O3/NOx/SO2/HF	Filters Changed	1
Riverlodge	2025-01-09	1500	2025-01-09	1500	O3/NOx/SO2/HF	O2 Tank Replacement	1
Riverlodge	2025-01-16	1200	2025-01-16	1300	PM10/PM2.5	Clock Reset	2
Riverlodge	2025-01-16	1400	2025-01-16	1700	O3/NOx/THC/SO2/HF	Official THC Setup and Calibration	4
Riverlodge	2025-01-23	1300	2025-01-23	1500	PM10/PM2.5	Monthly Flow Rate Verification and Maintenance	3
Riverlodge	2025-01-27	1400	2025-01-27	1500	PM2.5	Turned off during PM10 Troubleshooting	2
Riverlodge	2025-01-29	1000	2025-01-29	1500	O3/NOx/THC/SO2/HF	T700 Calibrator Troubleshooting	6
Riverlodge	2025-01-30	1300	2025-01-30	1600	O3/NOx/THC/SO2/HF	THC Calibration	4
Riverlodge	2025-01-31	1800	2025-01-31	1800	THC	Carrier Gas Replacement (H2/N2)	1
Riverlodge	2025-02-08	900	2025-02-08	900	PM10	Unit Repaired	1
Riverlodge	2025-02-08	1000	2025-02-11	900	PM10	72 Hour Zero Background Test	72
Riverlodge	2025-02-11	1000	2025-02-11	1500	PM10	BAM Setup Maintenance and Troubleshooting	6

Riverlodge	2025-02-11	1400	2025-02-11	1400	O3/NOx/THC/SO2/HF	Filter Changed	1
Riverlodge	2025-02-17	1400	2025-02-17	1600	PM10/PM2.5	Monthly Flow Rate Verification and Maintenance	3
Riverlodge	2025-02-26	1500	2025-02-26	1600	O3/NOx/THC/SO2/HF/P M10/PM2.5	MOE Audit	2
Riverlodge	2025-03-04	1300	2025-03-04	1300	O3/NOx/THC/SO2/HF	Filters Changed	1
Riverlodge	2025-03-04	1000	2025-03-04	1300	PM10/PM2.5	Monthly Flow Rate Verification and Maintenance	4
Riverlodge	2025-03-06	1600	2025-03-06	1600	THC	Affected during Site Maintenance	1
Riverlodge	2025-03-21	900	2025-03-21	900	O3/NOx/THC/SO2/HF	O3 As Found MP Verification	1
Whitesail	2025-01-23	1600	2025-01-23	1700	PM2.5	Monthly Flow Rate Verification and Maintenance	2
Whitesail	2025-02-06	1600	2025-02-06	1600	O3/NOx/SO2/THC	Filters Changed	1
Whitesail	2025-02-11	1600	2025-02-11	1700	PM2.5	Monthly Flow Rate Verification and Maintenance	2
Whitesail	2025-02-26	900	2025-02-26	1100	O3/NOx/SO2/THC/PM2 .5	MOE Audit	3
Whitesail	2025-03-06	900	2025-03-06	900	O3/NOx/SO2/THC	Filters Changed	1
Whitesail	2025-03-06	1100	2025-03-06	1200	PM2.5	Monthly Flow Rate Verification and Maintenance	2
Whitesail	2025-03-21	800	2025-03-21	1200	O3/NOx/SO2/THC	SO2/O3 As Found MP Verification; NOx Calibration	5